




**Z1108-L**  
ANGLED FLOW CONTROL

SPECIFICATION SHEET

TAG \_\_\_\_\_

Design and Dimensional Data (inches and [ mm ]) are Subject to Manufacturing Tolerances and Change Without Notice

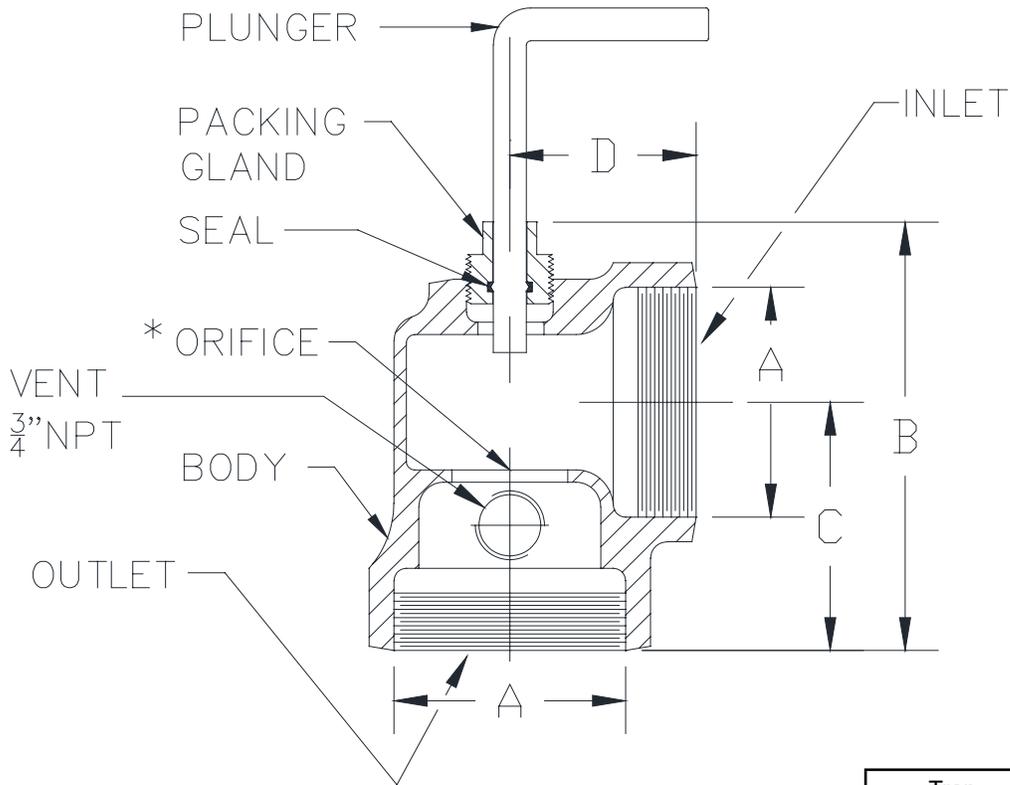

A	B	C	D
2 NPT	5-3/4 [146]	3-3/8 [86]	1-7/8 [48]
3 NPT	6-3/8 [162]	3-3/4 [95]	2-3/4 [70]

Trap Flow Rate Size/GPM	Standard Size Orifice Inches*
4 [15]	5/8 [16]
7 [26]	5/8 [16]
10 [38]	15/16 [24]
15 [57]	15/16 [24]
20 [76]	1 1/4 [32]
25 [95]	1 1/4 [32]
35 [132]	1 1/2 [38]
50 [189]	1 3/4 [44]

\*WITH 1' [305] (ONE FOOT OF HEAD)

**ENGINEERING SPECIFICATION:** ZURN Z1108-L Sani-Coated cast iron body with air intake opening.

Flow control is installed in line between fixture and grease interceptor. Its function is to regulate the flow so that it will not exceed the flow rate capacity of the grease interceptor, thus insuring foolproof operation and maximum efficiency. If the orifice becomes clogged with solid material, it can be cleared easily by using plunger. An air intake (or vent) must be used to insure proper operation of interceptor.

\* Regularly furnished unless otherwise specified

**⚠ WARNING:** Cancer and Reproductive Harm - [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)

**⚠ ADVERTENCIA:** Cáncer y daño reproductivo - [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)

**⚠ AVERTISSEMENT:** Cancer et effets néfastes sur la reproduction - [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)

Zurn Industries, LLC | Specification Drainage Operation  
1801 Pittsburgh Avenue, Erie, PA 16502, Ph. 855.663.9876

In Canada | Zurn Industries Limited  
7900 Goreway Drive, Unit 10, Brampton, Ontario L6T 5W6, Ph. 877.892.5216

[www.zurn.com](http://www.zurn.com)

Rev. D  
Date: 05/26/23  
C.N. No. 145178  
Prod. | Dwg. No. Z1108-L