


# PROCEPTOR OMC / GMC TRIPLE TANK 92" DIA ABOVE GROUND INSTALLATION PROCEDURE

## NOTES:

1. ENSURE FLOOR IS LEVEL, SMOOTH AND IS ABLE TO SUPPORT THE WEIGHT OF THE TANKS FULL OF WATER AT THE INSTALLATION LOCATION. TANK BOTTOM IS TO BE FULLY SUPPORTED.
2. MOVE TANKS INTO POSITION. CHECK FIT AND LOCATION OF INLET, OUTLET AND VENT PIPING.
3. IF APPLICABLE, CONNECT OUTLET OF UPSTREAM TANK WITH INLET OF DOWNSTREAM TANK.
4. ENSURE ACCESSWAY IS ACCESSIBLE FOR COVER REMOVAL AND PUMPOUT AS WELL AS ACCESS TO THE INTERIOR. ENSURE ALL OTHER PORTS ARE ACCESSIBLE FOR INSTALLATION AND MAINTENANCE. ALARM OR LEVEL PROBE (IF SUPPLIED) SHOULD HAVE SUFFICIENT HEADSPACE FOR REMOVAL FOR SERVICE.
5. ENSURE AREA AROUND TANK IS HEATED TO PREVENT FREEZING OF WATER IN TANKS AND PIPES.
6. THE STABILIZATION BRACKETS (IF EQUIPPED) MAY BE AFFIXED TO FLOOR IF DESIRED.
7. SEISMIC RESTRAINTS TO BE PROVIDED BY OTHERS IF REQUIRED BY LOCAL AUTHORITIES.
8. INSTALL INLET, OUTLET AND VENT PIPES TO MEET LOCAL PLUMBING CODE.
9. UNITS MUST BE INSTALLED IN ACCORDANCE WITH ALL RELEVANT FEDERAL, STATE/PROVINCIAL AND LOCAL CODES.

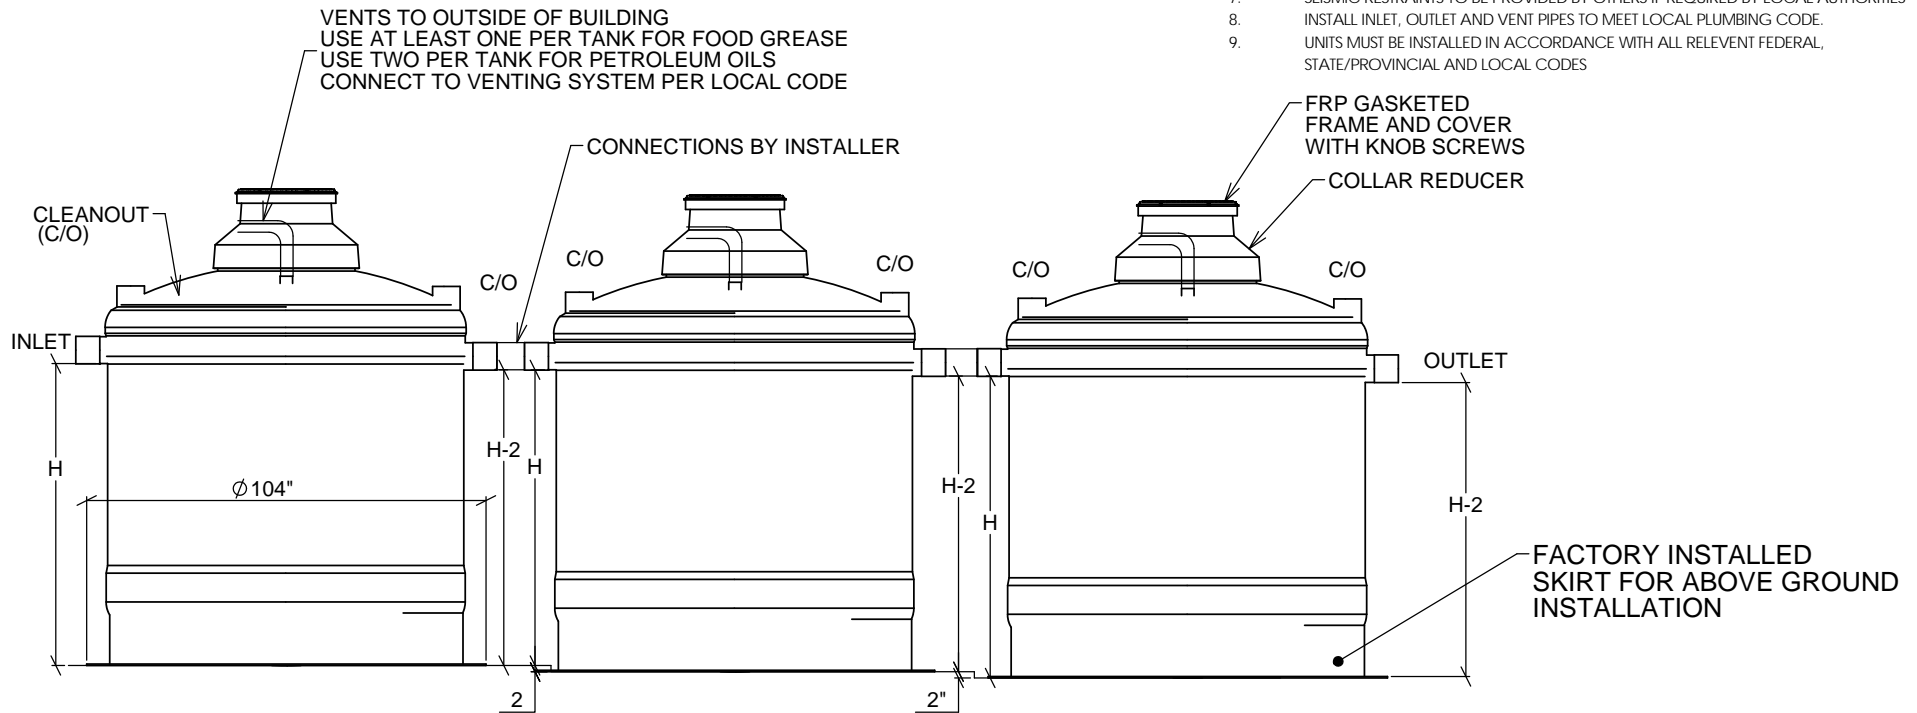

FLOOR LEVEL

STEPPED FLOOR CONFIGURATION

\* ACTUAL HEIGHT MAY VARY SLIGHTLY.

SECOND TANK TO BE INSTALLED 2 INCHES LOWER THAN FIRST TANK  
THIRD TANK TO BE INSTALLED 2 INCHES LOWER THAN SECOND TANK

PROCEPTOR SEPARATOR MODEL	INLET INVERT TO TANK BOTTOM (H")	WEIGHT OF TANKS FULL OF WATER (lbs)	WEIGHT OF EMPTY TANKS (lbs)
OMC/GMC 8000	104"	70700	3750
OMC/GMC 9000	115"	79350	4095
OMC/GMC 10,000	127"	87900	4350

TITLE: PROCEPTOR SEPARATOR INSTALLATION PROCEDURE ABOVE GROUND MC(3) MODELS ALL DIMENSIONS IN INCHES		REV	DATE	DRAWN
PROJECT: WO:		1		
		2		
		3	NOVEMBER 8, 2011	L. SIMKINS
		4	JULY 08, 2013	S. MANGAT
		5		
		6		
		7		
		8		
		9		
		10		
DRAWN BY: L. SIMKINS		SIZE DWG. NO.		
DRAWN DATE: MAY 2, 2008		A Install MC(3) $\phi 92"$ Above Ground		
		SCALE: NTS	DO NOT SCALE DRAWING	SHEET 1 OF 1

**Proceptor**<sup>®</sup>  
by greenturtle<sup>®</sup>  
US 877 428 8187 CAN 877 966 9444  
www.greenturtletech.com